


Primary Cooling Systems Among BASE Buildings*
n = 99 Buildings

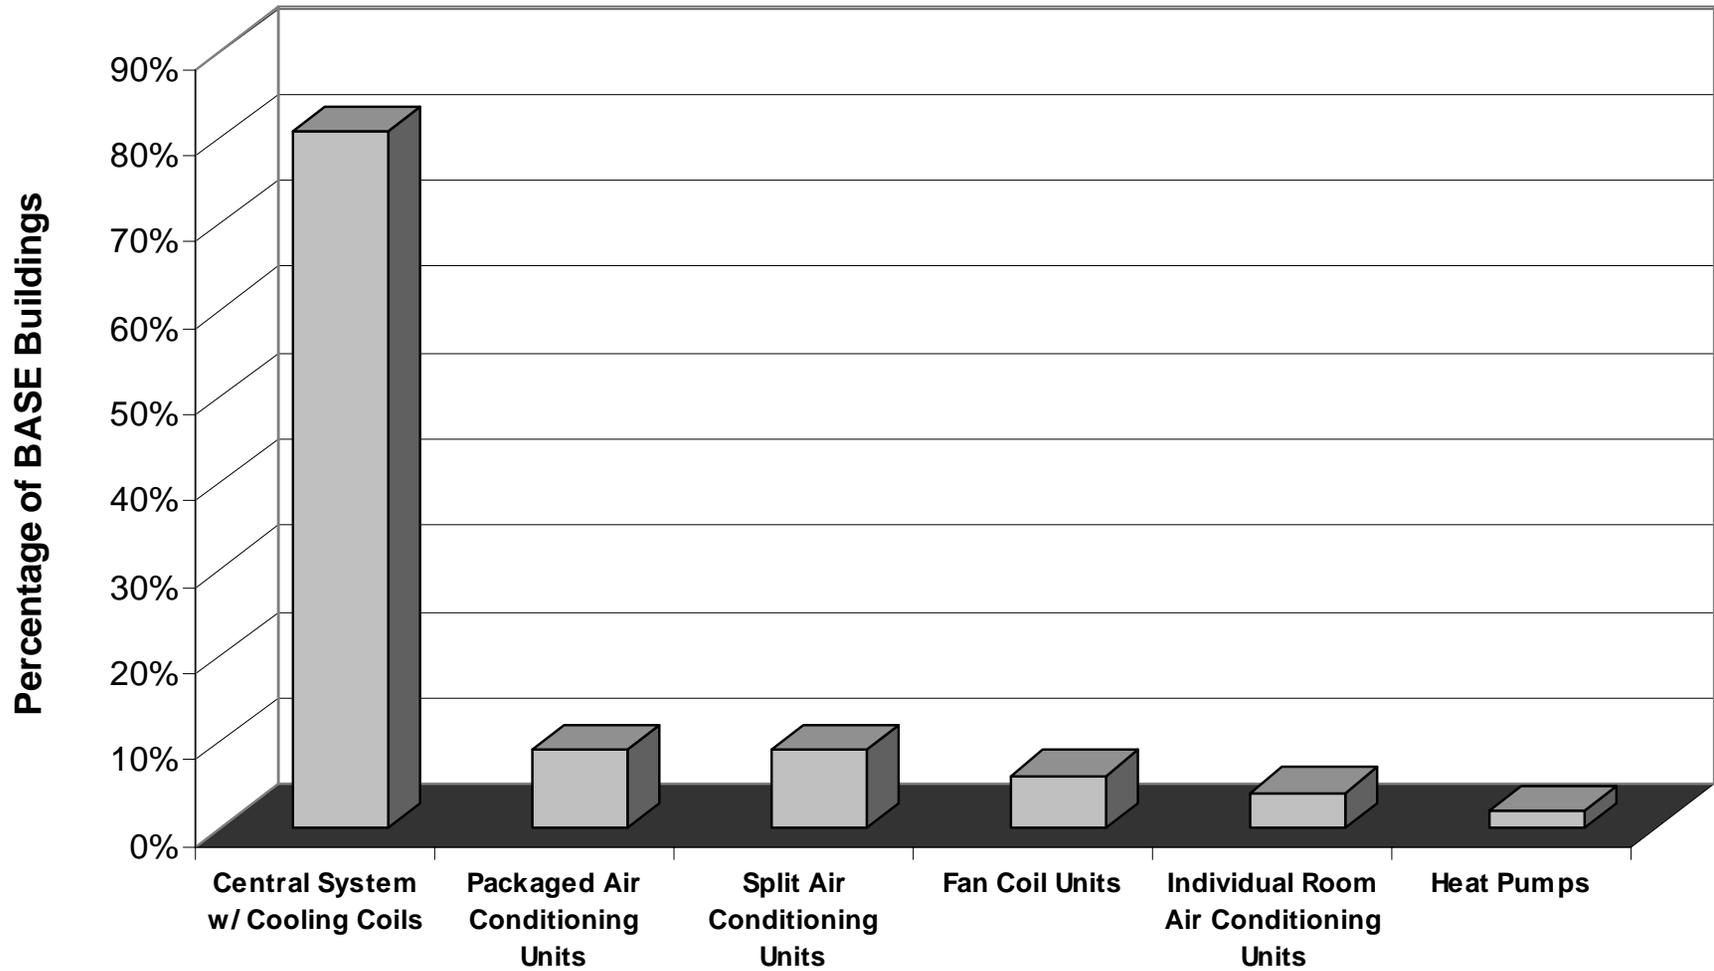

* Values sum to greater than 100% as some buildings had more than one primary cooling system